


- ① CONCRETE CURB AND GUTTER
TYPE A-1, SEE STD DETAIL 323
- ② 3/8" OR 1/2" x 2" DUMMY JOINT,
SEE SECTION 3.04. DUMMY JOINTS
SHALL ALIGN FROM CURB TO SIDEWALK.

ISOMETRIC VIEW

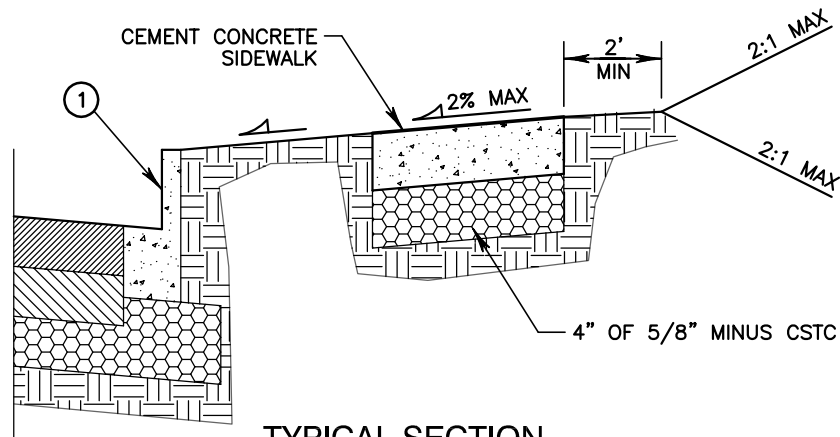


TYPICAL SECTION

NOTES:

1. SIDEWALKS ARE 5' TO 8' WIDE. SEE STANDARD DETAILS 202 - 207 FOR EXACT DIMENSIONS.
2. SIDEWALK CONCRETE SHALL BE 4" MIN. THICK (6" MIN. AT DRIVEWAYS, SEE DETAILS 303 - 304) AND SHALL BE PLACED ON 4" MIN. OF 5/8" MINUS CRUSHED SURFACING TOP COURSE COMPACTED TO 95% MAXIMUM DENSITY.
3. SIDEWALKS SHALL BE CLASS 4000 CEMENT CONCRETE WITH AIR ENTRAINMENT (4% MIN. 8% MAX.).
4. SIDEWALK CONCRETE FINISH SHALL BE BRUSHED TRANSVERSELY, DRIVEWAYS SHALL BE BRUSHED LONGITUDINALLY.
5. SIDEWALK JOINTS SHALL BE TOOLED WITH A 1/4"-R EDGER. EDGES SHALL BE TOOLED WITH A 1/2"-R EDGER.
6. FINISHED SIDEWALKS SHALL BE SPRAYED WITH A TRANSPARENT CURING COMPOUND COVERED BY WATERPROOF PAPER OR PLASTIC SHEETING IN THE EVENT OF RAIN FOR A MINIMUM OF 72 HOURS.
7. DUMMY JOINT SPACING MAY VARY (IN A CONSISTENT MANNER, 10' ±1') TO AVOID SHORT (<5') SEGMENTS.
8. PLANTER STRIP SHALL DRAIN TOWARD STREET AT 0 TO 10% CROSS-SLOPE.



City of Covington
Public Works
Community Development



**CONCRETE SIDEWALK
DETAIL**

This document has been signed electronically in accordance with WAC 196-23-070 and Chapter 19.34 RCW. Unauthorized alteration of any of the information on this document will invalidate the document, my certification and signature.

306

Revision Date
October 2009