


- ① CONCRETE CURB AND GUTTER
TYPE A-1, SEE STD DETAIL 323
- ② 3/8" OR 1/2" x 2" DUMMY JOINT,
SEE SECTION 3.04.
- ③ DETECTABLE WARNING STRIP PER
ADA ACCESSIBILITY GUIDELINES
4.29.2 AND 4.29.5.




NOTES:

1. SIDEWALKS ARE 5' TO 8' WIDE. SEE STANDARD DETAILS 202 – 207 FOR EXACT DIMENSIONS.
2. CURB RAMP CONCRETE SHALL BE 4" MIN. THICK AND SHALL BE PLACED ON 4" MIN. OF 5/8" MINUS CRUSHED SURFACING TOP COURSE COMPACTED TO 95% MAXIMUM DENSITY.
3. CURB RAMPS SHALL BE CLASS 4000 CEMENT CONCRETE WITH AIR ENTRAINMENT (4% MIN. 8% MAX.).
4. CURB RAMP CONCRETE FINISH SHALL BE BRUSHED TRANSVERSELY,
5. CURB RAMP JOINTS SHALL BE TOOLED WITH A 1/4"-R EDGER. EDGES SHALL BE TOOLED WITH A 1/2"-R EDGER.
6. FINISHED CURB RAMPS SHALL BE SPRAYED WITH A TRANSPARENT CURING COMPOUND COVERED BY WATERPROOF PAPER OR PLASTIC SHEETING IN THE EVENT OF RAIN FOR A MINIMUM OF 72 HOURS.
7. NO CATCH BASINS, METER BOXES, MANHOLES OR CLEANOUTS SHALL BE LOCATED WITHIN THE CURB RAMP WIDTH.

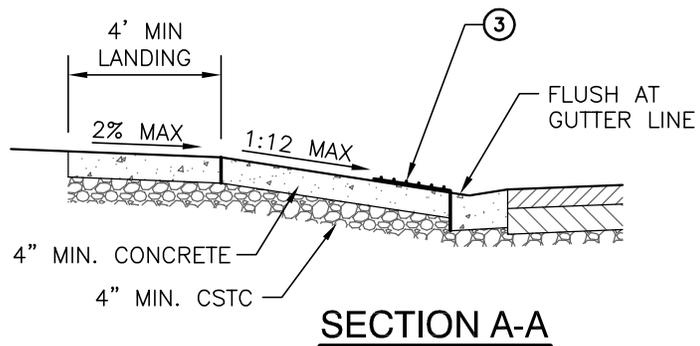

City of Covington
Public Works
Community Development



**WHEELCHAIR RAMP
TYPE C**

This document has been signed electronically in accordance with WAC 196-23-070 and Chapter 19.34 RCW. Unauthorized alteration of any of the information on this document will invalidate the document, my certification and signature.

310

Revision Date
October 2009