




**RAILING OPENING LIMITS:**  
 (A) A 4" DIA. SPHERE CAN NOT PASS THROUGH

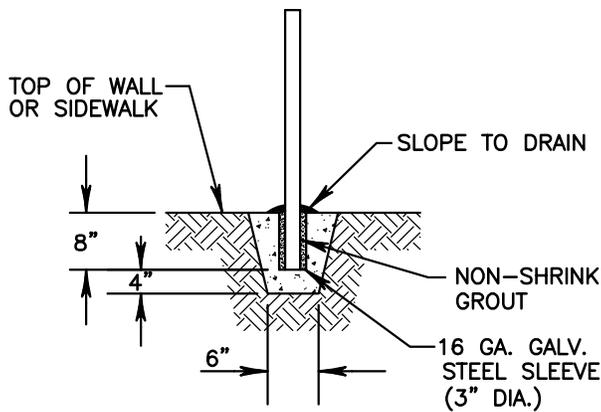

**DETAIL A**  
 Q POST

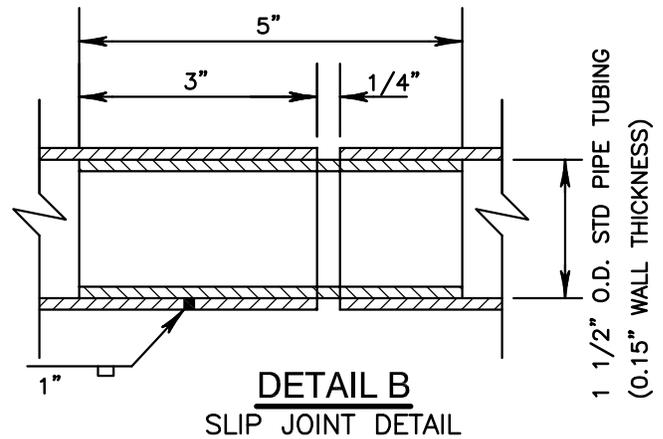

**DETAIL B**  
 SLIP JOINT DETAIL

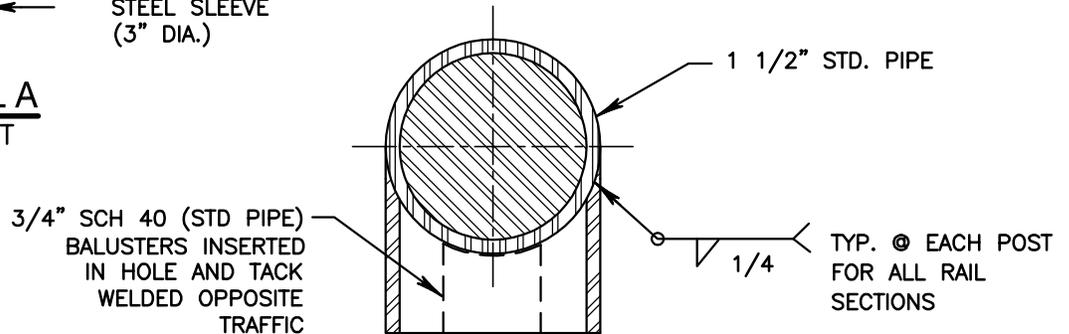

3/4" SCH 40 (STD PIPE) BALUSTERS INSERTED IN HOLE AND TACK WELDED OPPOSITE TRAFFIC


TYP. @ EACH POST FOR ALL RAIL SECTIONS

**NOTES:**

1. MATERIAL FOR PEDESTRIAN HANDRAIL SHALL BE ALUMINUM (ASTM B-429) OR HOT DIPPED GALVANIZED STEEL (ASTM 120), AS APPROVED BY THE DIRECTOR.
2. SEE STANDARD DETAIL 317 FOR ADDITIONAL FABRICATION AND SPECIFICATION REQUIREMENTS.



**City of Covington**  
 Public Works  
 Community Development



**PEDESTRIAN RAILING**

This document has been signed electronically in accordance with WAC 196-23-070 and Chapter 19.34 RCW. Unauthorized alteration of any of the information on this document will invalidate the document, my certification and signature.

**316**

Revision Date  
 July 2009