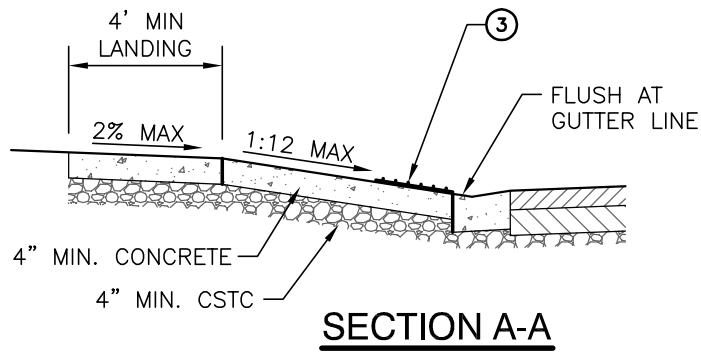




- ① CONCRETE CURB AND GUTTER TYPE A-1, SEE STD DETAIL 323
- ② 3/8" OR 1/2" x 2" DUMMY JOINT, SEE SECTION 3.04.
- ③ DETECTABLE WARNING STRIP PER ADA ACCESSIBILITY GUIDELINES 4.29.2 AND 4.29.5.



- NOTES:
1. SIDEWALKS ARE 5' TO 8' WIDE. SEE STANDARD DETAILS 202 - 207 FOR EXACT DIMENSIONS.
 2. CURB RAMP CONCRETE SHALL BE 4" MIN. THICK AND SHALL BE PLACED ON 4" MIN. OF 5/8" MINUS CRUSHED SURFACING TOP COURSE COMPACTED TO 95% MAXIMUM DENSITY.
 3. CURB RAMP SHALL BE CLASS 4000 CEMENT CONCRETE WITH AIR ENTRAINMENT (4% MIN. 8% MAX.).
 4. CURB RAMP CONCRETE FINISH SHALL BE BRUSHED TRANSVERSELY,
 5. CURB RAMP JOINTS SHALL BE TOOLED WITH A 1/4"-R EDGER. EDGES SHALL BE TOOLED WITH A 1/2"-R EDGER.
 6. FINISHED CURB RAMP SHALL BE SPRAYED WITH A TRANSPARENT CURING COMPOUND COVERED BY WATERPROOF PAPER OR PLASTIC SHEETING IN THE EVENT OF RAIN FOR A MINIMUM OF 72 HOURS.
 7. NO CATCH BASINS, METER BOXES, MANHOLES OR CLEANOUTS SHALL BE LOCATED WITHIN THE CURB RAMP WIDTH.

 <p>City of Covington Public Works Community Development</p>	 <p>DONALD M. VONDRA STATE OF WASHINGTON PROFESSIONAL ENGINEER 038844</p>	<p>WHEELCHAIR RAMP TYPE A</p> <p>This document has been signed electronically in accordance with WAC 196-23-070 and Chapter 19.34 RCW. Unauthorized alteration of any of the information on this document will invalidate the document, my certification and signature.</p>	<p>308</p> <p>Revision Date October 2009</p>
---	--	--	---