


TABLE A

| PROJECT SIZE | LENGTH OF | |
|--------------|---------------|-----|
| | QUARRY SPALLS | ATB |
| RESID. LOT | 20 | 0 |
| < 1/4 ACRE | 30 | 0 |
| < 1 ACRE | 50 | 0 |
| < 3 ACRE | 100 | 0 |
| > 3 ACRE | 100 | 50 |

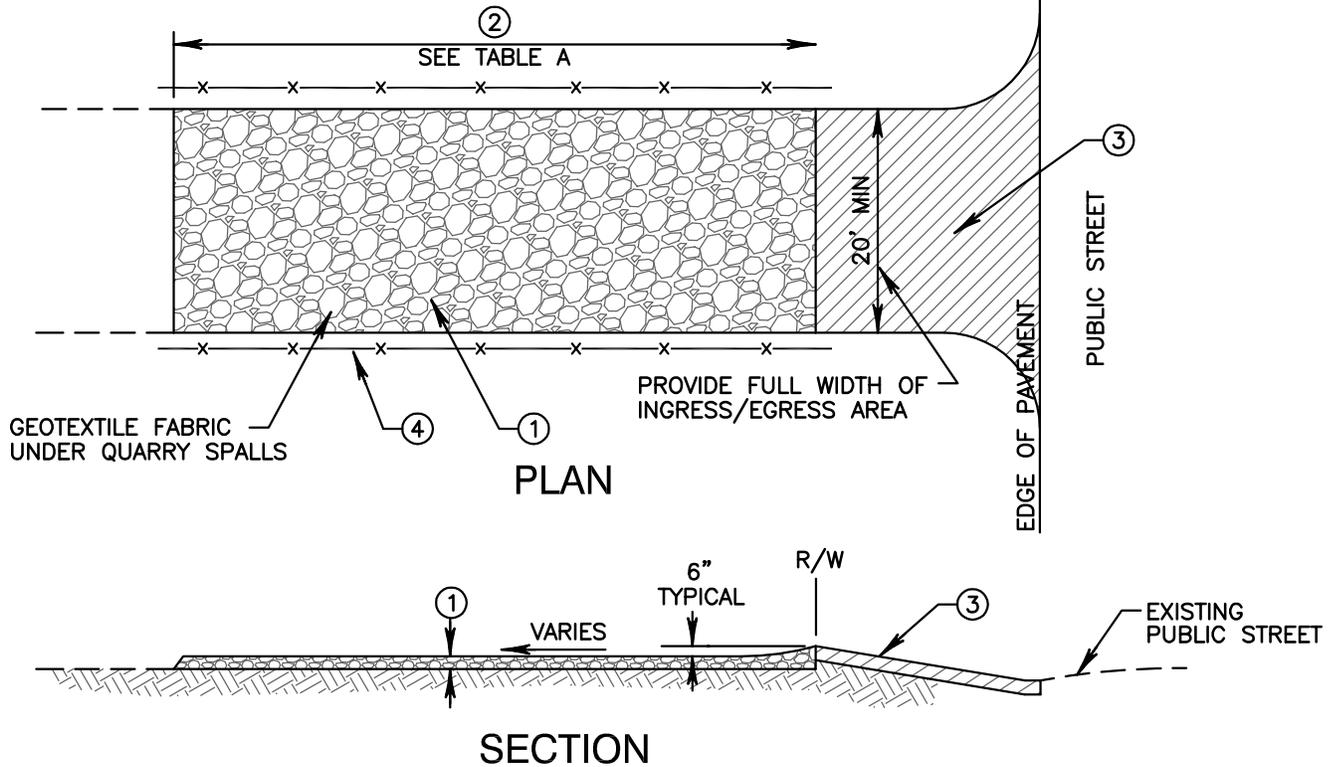

DETAIL NOTES


Surface Water – All surface water flowing or diverted toward construction entrances shall be piped across the entrance. If piping is impractical, a mountable berm with 5:1 slopes will be permitted. Surface water shall be routed to erosion control BMPs prior to discharge from site.

Maintenance – The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public right-of-way. This may require periodic top dressing with additional stone as conditions demand and repair and/or cleanout of any measures used to trap sediment. All sediment spilled, dropped, washed or tracked onto public right-of-way must be removed immediately.

Wheels shall be cleaned to remove sediment prior to entrance onto public right-of-way. When washing is used, it shall be done on an area stabilized with stone and which drains into an approved sediment trapping device.

Periodic inspection and needed maintenance shall be provided after each rain event.

- ① 4" TO 8" THICKNESS FOR COMMERCIAL SITES, 4" TO 6" THICKNESS FOR RESIDENTIAL SITES. QUARRY SPALLS AS SPECIFIED IN SECTION 9-13.6 OF THE WSDOT/APWA STANDARD SPECIFICATIONS.
- ② THE MINIMUM LENGTH SHALL BE INCREASED AS NECESSARY TO ENSURE MATERIAL IS NOT TRACKED INTO THE PUBLIC RIGHT-OF-WAY. ALTERNATE CONSTRUCTION ENTRANCES MAY BE ALLOWED WITH APPROVAL OF THE CITY ENGINEER ON A CASE BY CASE BASIS, WHERE PHYSICAL SITE CONDITIONS AND SIZE DICTATE.
- ③ ATB DRIVEWAY RAMP, OR SITE ACCESS ROAD 20' WIDE MIN. SEE TABLE A FOR REQUIRED LENGTH.
- ④ INSTALL ORANGE BARRIER FENCE TO DIRECT TRAFFIC ONTO CONSTRUCTION ENTRANCE.

| | | | |
|---|---|--|---|
|  <p>City of Covington Public Works Community Development</p> |  <p>DONALD M. VONDRA STATE OF WASHINGTON PROFESSIONAL ENGINEER 038844</p> | <p>STABILIZED CONSTRUCTION ENTRANCE</p> <p style="font-size: small;">This document has been signed electronically in accordance with WAC 196-23-070 and Chapter 19.34 RCW. Unauthorized alteration of any of the information on this document will invalidate the document, my certification and signature.</p> | <p>705</p> <p>Revision Date October 2009</p> |
|---|---|--|---|